


SECONDARY SUITE NOTES:

- 1 - VENTILATION SYSTEM & FAN CONTROL SHALL COMPLY TO 9.32.3.
- 2 - EACH DWELLING UNIT SHALL HAVE SEPARATE VENTILATION SYSTEM
- 3 - ELECTRIC BASEBOARD HEATERS c/w SEPARATE THERMOSTAT CONTROL
- 4 - NO POT-LIGHTS PERMITTED IN SECONDARY SUITE
- unless each pot-light compartment individually fire separated
- 5 - 45mins. FIRE RATED CEILING AS PER 9.36.2.16
- one layer of 1/2" type 'X' drywall
(30mins. IF an additional photo-electric smoke alarm is interconnected between the principal dwelling & secondary suite as per 9.36.2.20)
- 6 - 45mins. FIRE RATED WALLS AS PER 9.36.2.16
- one layer of 1/2" type 'X' drywall
(30mins. IF an additional photo-electric smoke alarm is interconnected between the principal dwelling & secondary suite as per 9.36.2.20)

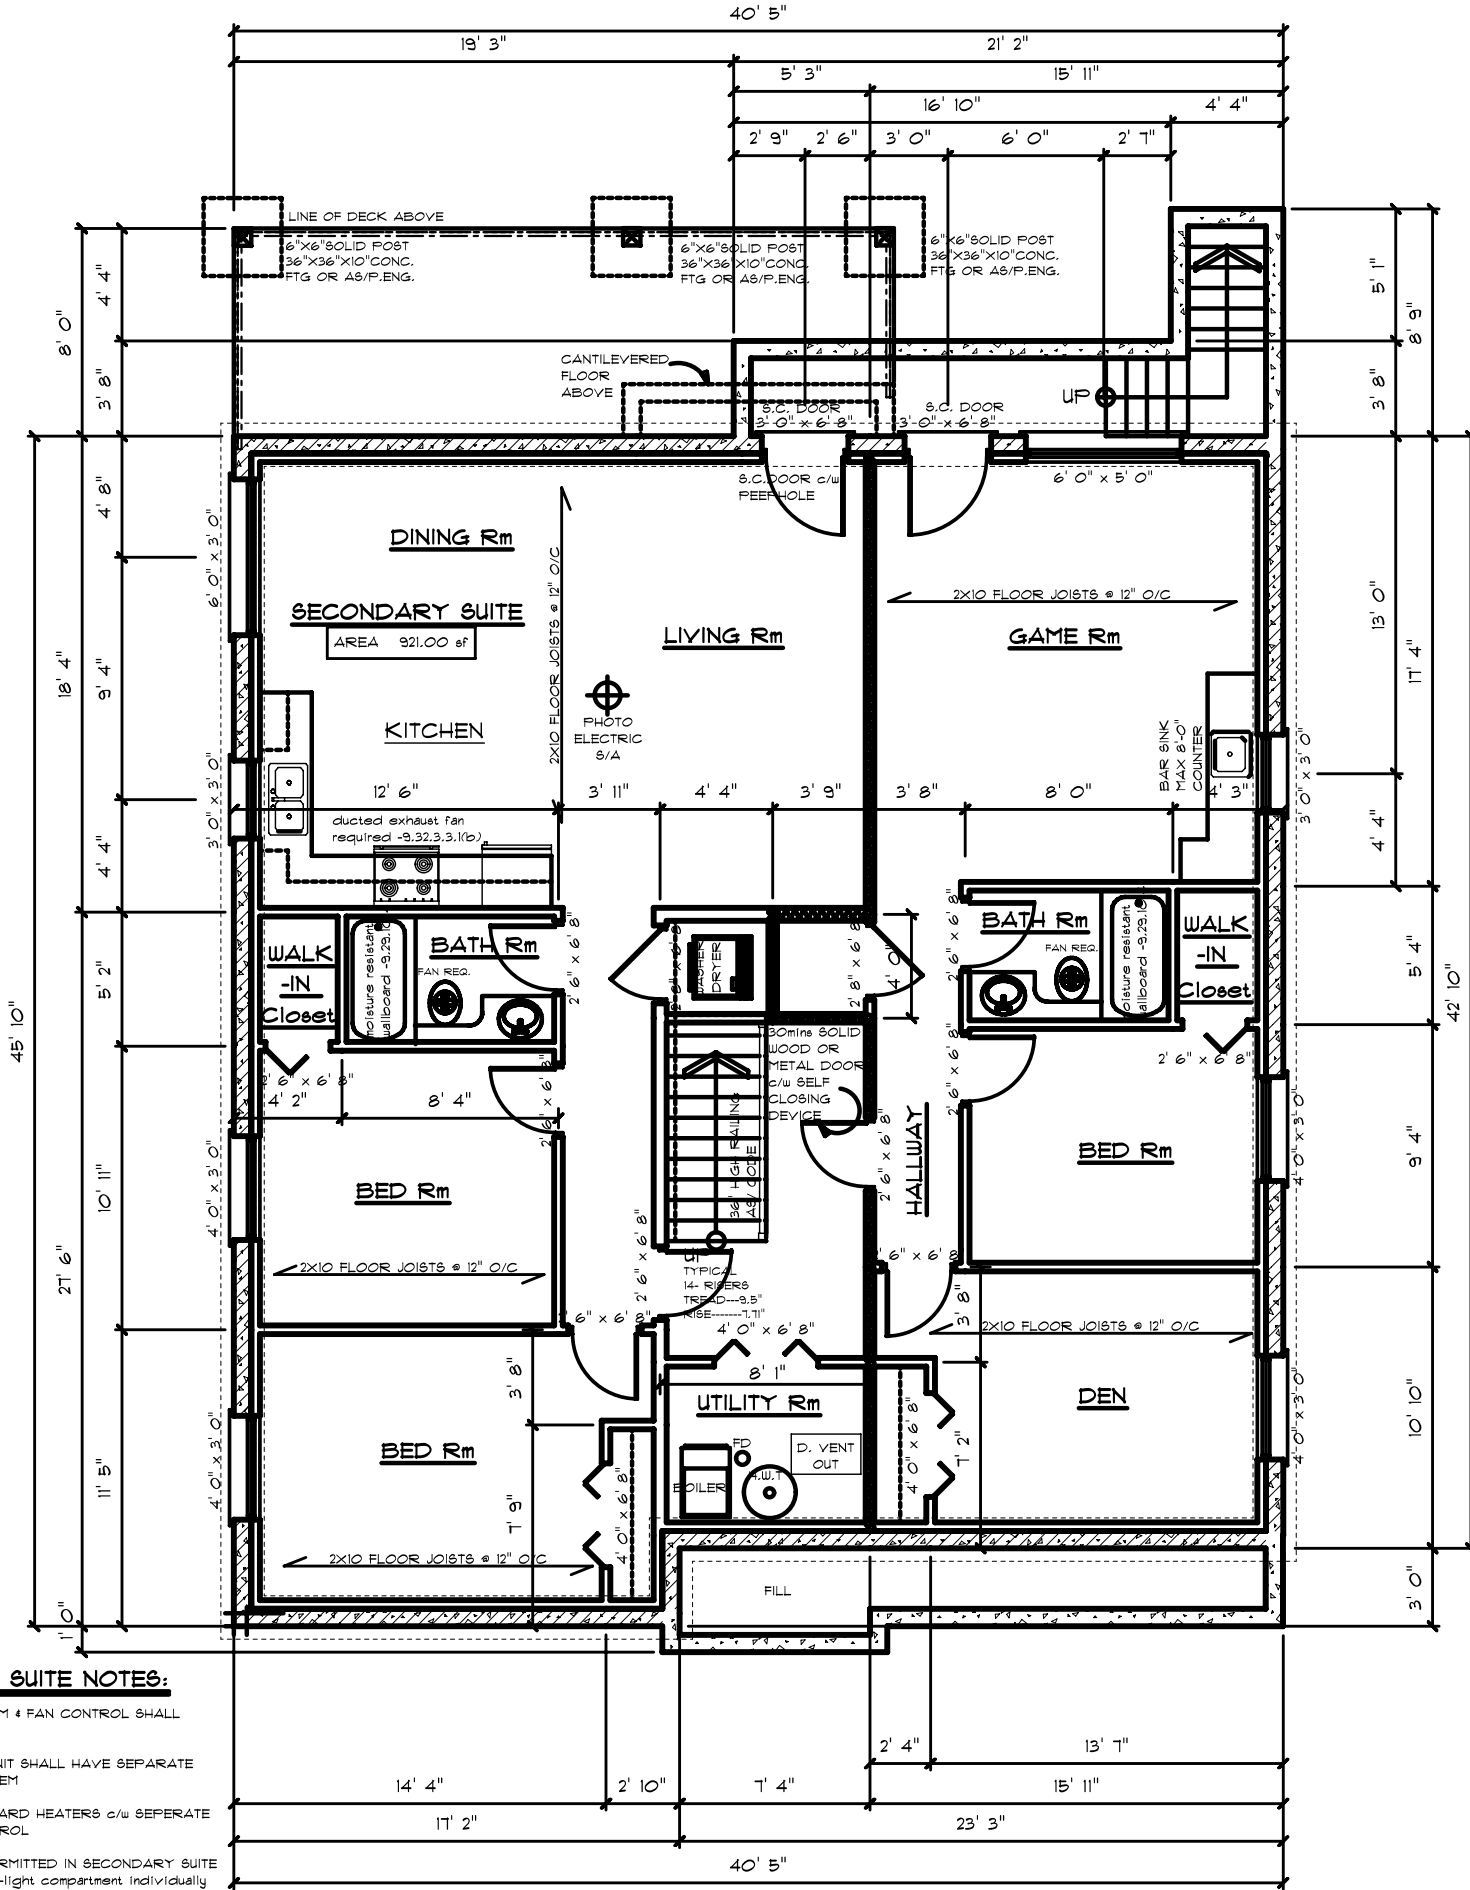

BASEMENT PLAN

NET FLOOR AREA 1 782.00 SF